

# AMS2000-2600 - Precalibrated Gas Sensor Module

## Features:

- \* High sensitivity to deoxidizing gases in air contaminants
- \* Long life
- \* Maintenance free

The AMS 2000-2600 gas sensor module is factory pre-calibrated for usage in conjunction with system feature control microprocessors FIC93619A or FIC5603.


The module is composed of Figaro Gas Sensor TGS2600 and a load resistor on a PCB, an XHP-3 connector, and three lead wires. Because of its wide sensitivity spectrum and low power consumption, TGS2600 is the ideal sensor for the detection of indoor air pollution which is caused by cigarette smoke, cooking fumes, etc. This module enables users to create a low cost indoor air monitor by eliminating the need for a sophisticated calibration process.

## Application:

- \* Air quality control device



## Electronic Circuit

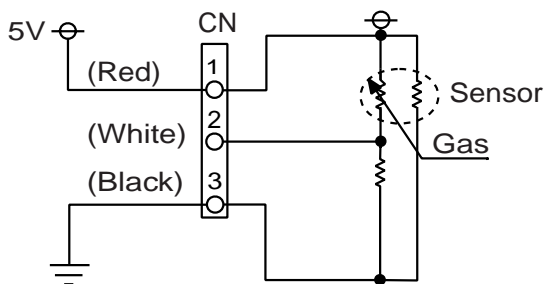

## Terminal Connections


Terminal	Name	Function
1 (red)	Input	heater voltage (VH) circuit voltage (VC)
2 (white)	Output	output voltage (Vout)
3 (black)	Common	ground (GND)

## Specifications

Item	Specification
Model No.	AMS2000-2600
Target gas	deoxidizing gases in air contaminants
Sensor	TGS2600
Input voltage	5.0±0.2v DC
Power consumption	approx. 210mW
Connector	XHP-3
Operating temperature	-10 ~ 40°C
Storage temperature	-20 ~ 60°C
Dimensions	PCB : 37 x 22 x 13mm lead wire length : 300±10mm
Weight	approx. 20g
Vair (Vout in clean air at 20±2°C/65±5%RH)	0.7 ~ 2.5v typical value = 1.5
Sensitivity [Rs(H2 10ppm)/Rs(air)]	0.18 ~ 0.62 typical value = 0.4

**Dimensions**

Tolerance of PCB : ±0.2

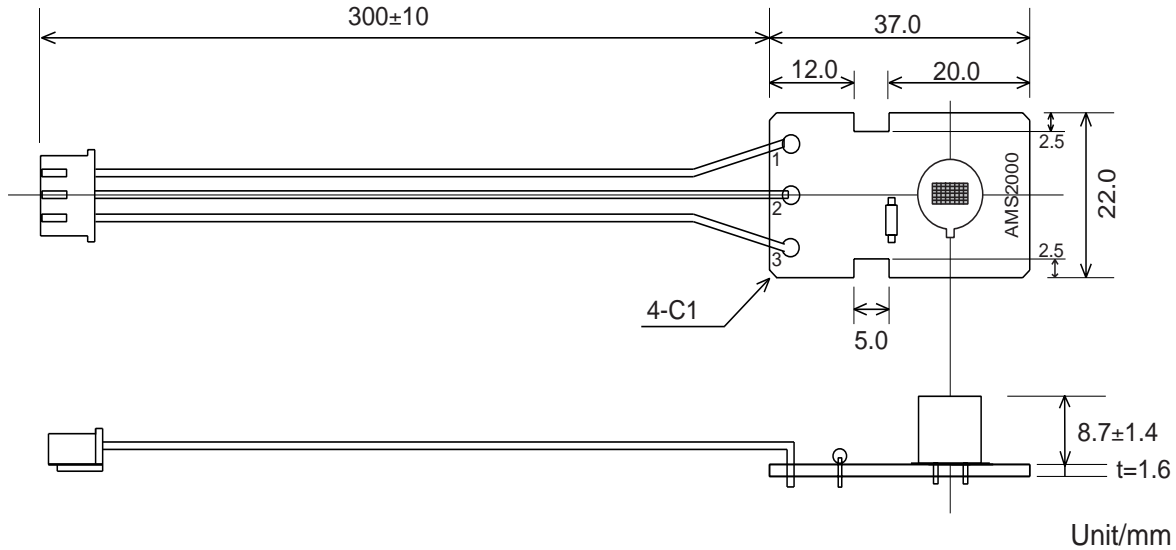

**Standard Test Conditions**

Item	Test Condition
Temperature	20±2°C
Humidity	65±5%RH
Test gas	Hydrogen > 99% purity
Test gas concentration	10ppm
Input voltage	5.0v DC ± 4%
Sensor preheating prior to test	≥24 hours in clean air
Test chamber capacity	≥ 1 liter per sensor

**Notes:**

Figaro recommends this product be used in conjunction with Figaro's special microprocessor (FIC93619A or FIC5603) when making an air quality control device.

Figaro's products are not authorized for use as critical components in life support applications wherein a failure or malfunction of the products may result in injury or threat to life.

Figaro Engineering Inc. (Figaro) reserves the right to make changes without notice to any products herein to improve reliability, functioning or design. Information contained in this document is believed to be reliable. However, Figaro does not assume any liability arising out of the application or use of any product or circuit described herein; neither does it convey any license under its patent rights, nor the rights of others.

**FIGARO GROUP**

**HEAD OFFICE**

**Figaro Engineering Inc.**  
 1-5-11 Senba-nishi  
 Mino, Osaka 562 JAPAN  
 Tel.: (81) 727-28-2561  
 Fax: (81) 727-28-0467  
 email: figaro@figaro.co.jp

**OVERSEAS**

**Figaro USA Inc.**  
 3703 West Lake Ave. Suite 203  
 Glenview, IL 60025 USA  
 Tel.: (1) 847-832-1701  
 Fax.: (1) 847-832-1705  
 email: figarousa@figarosensor.com